



COURSE OVERVIEW FE0027

API 521: Pressure Relieving & De-Pressuring Systems

Course Title

API 521: Pressure Relieving & De-Pressuring Systems

Course Date/Venue

December 08-12, 2025/Slaysel 02 Meeting Room, Movenpick Hotel & Resort Al Bida'a Kuwait, City of Kuwait

Course Reference

FE0027



Course Duration/Credits

Five days/3.0 CEUs/30 PDHs

Course Description



This practical and highly-interactive course includes various practical sessions and exercises. Theory learnt in the class will be applied using the following practical methods:

(1) Valve Demo Kit: Various safety relief valves will be distributed in the class to the participants by the course instructor for hands-on demonstration. These demo kits will be returned to the instructor at the end of the training day.

(2) Valve Simulator: Participants will use in the class our state-of-the-art valve simulators to practice some of the skills learnt.



This course is applicable to pressure-relieving and vapor depressuring systems. Although intended for use primarily in oil refineries, it is also applicable to petrochemical facilities, gas plants, liquefied natural gas (LNG) facilities, and oil and gas production facilities. The information provided is designed to aid in the selection of the system that is most appropriate for the risks and circumstances involved in various installations.



This course specifies requirements and gives guidelines for examining the principal causes of overpressure; determining individual relieving rates; selecting and designing disposal systems including such component parts as piping, vessels, flares and vent stacks.

This course is designed to provide participants with a detailed and up-to-date overview of pressure relieving and de-pressuring systems in accordance with API 521. It covers the causes of overpressure and their relieving rates; the overpressure protection philosophy; the determination of individual relieving rates; the individual overpressure causes and their relieving rates; the causes for vacuum and protection against vacuum; the vapor depressuring; and the relief system design and flare header design documentation.

During this interactive course, participants will learn the special considerations for individual PRDs including disposal systems and fluid properties that influence selection and design of disposal systems; the system design load, system arrangement, piping and disposal to a lower-pressure system; and the disposal to flare, disposal to atmosphere and design details for seal and knockout drum.

Course Objectives

Upon the successful completion of this course, each participant will be able to:-

- Apply and gain an in-depth knowledge on pressure relieving and de-pressuring systems in accordance with API 521
- Discuss the causes of overpressure and their relieving rates
- Explain the overpressure protection philosophy including the determination of individual relieving rates as well as the individual overpressure causes and their relieving rates
- Identify the causes for vacuum and protection against vacuum
- Describe vapor depressuring and review relief system design and flare header design documentation
- Recognize the special considerations for individual PRDs including disposal systems and fluid properties that influence selection and design of disposal systems
- Illustrate system design load, system arrangement, piping and disposal to a lower-pressure system
- Discuss disposal to flare, disposal to atmosphere and design details for seal and knockout drum

Exclusive Smart Training Kit - H-STK®



*Participants of this course will receive the exclusive “Howard Smart Training Kit” (H-STK®). The H-STK® consists of a comprehensive set of technical content which includes **electronic version** of the course materials conveniently saved in a **Tablet PC**.*

Who Should Attend

This course provides an overview of all significant aspects and considerations of pressure relieving and de-pressuring systems in accordance with API 521 for process engineers involved in relief and flare selection and sizing; operation engineers who have oversight responsibility for flare design and operation; and technical personnel and supervisors involved in supporting relief flare operation.

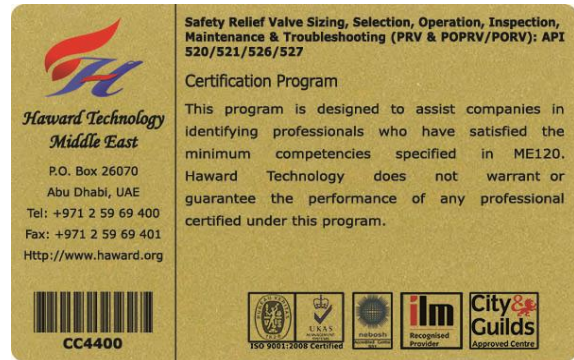
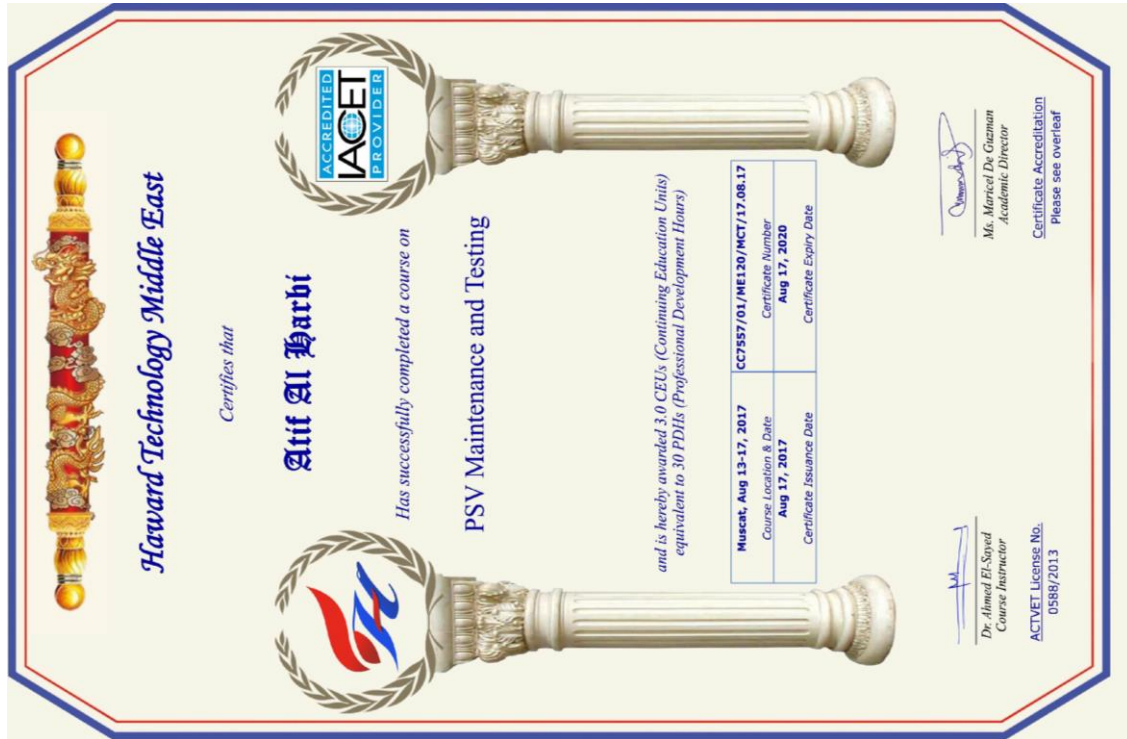
Course Certificate(s)

- (1) Internationally recognized Wall Competency Certificates and Plastic Wallet Card Certificates will be issued to participants who completed a minimum of 80% of the total tuition hours and successfully passed the exam at the end of the course. Certificates are valid for 5 years.

Recertification is FOC for a Lifetime.

Sample of Certificates

The following are samples of certificates that will be awarded to course participants:-



- (2) Official Transcript of Records will be provided to the successful delegates with the equivalent number of ANSI/IACET accredited Continuing Education Units (CEUs) earned during the course.

* Haward Technology * CEUs * Haward Technology * CEUs * Haward Technology * CEUs * Haward Technology *



Page 1 of 1

Haward Technology Middle East
Continuing Professional Development (HTME-CPD)

CEUs

CEU Official Transcript of Records

TOR Issuance Date: 28-Sep-17

HTME No. PAR213250

Participant Name: Taher Al Mazrouei

Program Ref.	Program Title	Program Date	No. of Contact Hours	CEU's
ME120	Safety Relief Valve Sizing, Selection, Operation, Inspection, Maintenance & Troubleshooting (PRV & POPRV/PORV): API 520/521/526/527	September 24-28, 2017	30	3.0

Total No. of CEU's Earned as of TOR Issuance Date **3.0**

TRUE COPY


 Maricel De Guzman
 Academic Director

Haward Technology is an Authorized Training Provider by the International Association for Continuing Education and Training (IACET), 11130 Sunrise Valley Drive, Suite 350 Reston, VA 20191, USA. In obtaining this approval, Haward Technology has demonstrated that it complies with the ANSI/IACET 1-2013 Standard which is widely recognized as the standard of good practice internationally. As a result of their Authorized Provider membership status, Haward Technology is authorized to offer IACET CEUs for programs that qualify under the ANSI/IACET 1-2013 Standard.

Haward Technology's courses meet the professional certification and continuing education requirements for participants seeking Continuing Education Units (CEUs) in accordance with the rules & regulations of the International Association for Continuing Education & Training (IACET). IACET is an international authority that evaluates programs according to strict, research-based criteria and guidelines. The CEU is an internationally accepted uniform unit of measurement in qualified courses of continuing education.

Haward Technology is accredited by




P.O. Box 26070, Abu Dhabi, United Arab Emirates | Tel.: +971 2 3091 714 | Fax: +971 2 3091 716 | E-mail: info@haward.org | Website: www.haward.org

* Haward Technology * CEUs * Haward Technology * CEUs * Haward Technology * CEUs * Haward Technology *

Certificate Accreditations

Certificates are accredited by the following international accreditation organizations: -

- 
British Accreditation Council (BAC)

Haward Technology is accredited by the **British Accreditation Council for Independent Further and Higher Education** as an **International Centre**. BAC is the British accrediting body responsible for setting standards within independent further and higher education sector in the UK and overseas. As a BAC-accredited international centre, Haward Technology meets all of the international higher education criteria and standards set by BAC.

- 
The International Accreditors for Continuing Education and Training (IACET - USA)

Haward Technology is an Authorized Training Provider by the International Accreditors for Continuing Education and Training (IACET), 2201 Cooperative Way, Suite 600, Herndon, VA 20171, USA. In obtaining this authority, Haward Technology has demonstrated that it complies with the **ANSI/IACET 2018-1 Standard** which is widely recognized as the standard of good practice internationally. As a result of our Authorized Provider membership status, Haward Technology is authorized to offer IACET CEUs for its programs that qualify under the **ANSI/IACET 2018-1 Standard**.

Haward Technology's courses meet the professional certification and continuing education requirements for participants seeking **Continuing Education Units (CEUs)** in accordance with the rules & regulations of the International Accreditors for Continuing Education & Training (IACET). IACET is an international authority that evaluates programs according to strict, research-based criteria and guidelines. The CEU is an internationally accepted uniform unit of measurement in qualified courses of continuing education.

Haward Technology Middle East will award **3.0 CEUs** (Continuing Education Units) or **30 PDHs** (Professional Development Hours) for participants who completed the total tuition hours of this program. One CEU is equivalent to ten Professional Development Hours (PDHs) or ten contact hours of the participation in and completion of Haward Technology programs. A permanent record of a participant's involvement and awarding of CEU will be maintained by Haward Technology. Haward Technology will provide a copy of the participant's CEU and PDH Transcript of Records upon request.

Course Instructor(s)

This course will be conducted by the following instructor(s). However, we have the right to change the course instructor(s) prior to the course date and inform participants accordingly:



Mr. Manuel Dalas MSc, BSc, is a Senior Mechanical & Maintenance Engineer with over 25 years of industrial experience in Oil, Gas, Refinery, Petrochemical, Power and Nuclear industries. His wide expertise includes Gas Turbines & Compressors Troubleshooting, Gas Turbines Performance, Maintenance & Testing, Gas Turbine Performance and Optimization, Gas Turbine Control

Systems, Advanced Gas Turbine, Gas Turbine Design and Analysis, Air Compressor & Gas Turbines Selection and Design, Material Cataloguing, Maintenance Planning & Scheduling, Reliability Centered Maintenance (RCM), Reliability Maintenance, Condition Based Maintenance & Condition Monitoring, Asset & Risk Management, Vibration Condition Monitoring & Diagnostics of Machines, Vibration & Predictive Maintenance, Reliability Improvement & Vibration Analysis for Rotating Machinery, Effective Maintenance Shutdown & Turnaround Management, Engineering Codes & Standards, Rotating Equipment Maintenance, Mechanical Troubleshooting, Static Mechanical Equipment Maintenance, Machinery Failure Analysis, Machinery Diagnostics & Root Cause Failure Analysis, Plant Reliability & Maintenance Strategies, Boiler Operation & Water Treatment, Pumps Maintenance & Troubleshooting, Fans, Blowers & Compressors, Process Control Valves, Piping Systems & Process Equipment, Advanced Valve Technology, Pressure Vessel Design & Analysis, Steam & Gas Turbine, High Pressure Boiler Operation, FRP Pipe Maintenance & Repair, Centrifugal & Positive Displacement Pump Technology Troubleshooting & Maintenance, Rotating Machinery Best Practices, PD Compressor & Gas Engine Operation & Troubleshooting, Hydraulic Tools & Fitting, Mass & Material Balance, Water Distribution & Pump Station, Tank Farm & Tank Terminal Safety & Integrity Management, Process Piping Design, Construction & Mechanical Integrity, Stack & Noise Monitoring, HVAC & Refrigeration Systems, BPV Code, Section VIII, Division 2, Facility Planning & Energy Management, Hoist - Remote & Basic Rigging & Slings, Mobile Equipment Operation & Inspection, Heat Exchanger, Safety Relief Valve, PRV & POPRV/PORV, Bearing & Lubrication, Voith Coupling Overhaul, Pump & Valve Technology, Lubrication Inspection, Process Plant Optimization, Rehabilitation, Revamping & Debottlenecking, Engineering Problem Solving and Process Plant Performance & Efficiency. Currently, he is the Technical Consultant of the Association of Local Authorities of Greater Thessaloniki where he is in charge of the mechanical engineering services for piping, pressure vessels fabrications and ironwork.

During his career life, Mr. Dalas has gained his practical and field experience through his various significant positions and dedication as the **Technical Manager, Project Engineer, Safety Engineer, Deputy Officer, Instructor, Construction Manager, Construction Engineer, Consultant Engineer and Mechanical Engineer** for numerous multi-billion companies including the **Biological Recycling Unit** and the **Department of Supplies of Greece, Alpha Bank Group, EMKE S.A, ASTE LLC and Polytechnic College of Evosmos.**

Mr. Dalas has a **Master's degree in Energy System** from the **International Hellenic University, School of Science & Technology** and a **Bachelor's degree in Mechanical Engineering** from the **Mechanical Engineering Technical University of Greece** along with a **Diploma in Management & Production Engineering** from the **Technical University of Crete**. Further, he is a **Certified Internal Verifier/Assessor/Trainer** by the **Institute of Leadership and Management (ILM)**, a **Certified Project Manager Professional (PMI-PMP)**, a **Certified Instructor/Trainer**, a **Certified Energy Auditor for Buildings, Heating & Climate Systems**, a **Member of the Hellenic Valuation Institute** and the **Association of Greek Valuers** and a **Licensed Expert Valuer Consultant** of the **Ministry of Development and Competitiveness**. He has further delivered numerous trainings, courses, seminars, conferences and workshops internationally.

Training Methodology

All our Courses are including **Hands-on Practical Sessions** using equipment, State-of-the-Art Simulators, Drawings, Case Studies, Videos and Exercises. The courses include the following training methodologies as a percentage of the total tuition hours:-

- 30% Lectures
- 20% Practical Workshops & Work Presentations
- 30% Hands-on Practical Exercises & Case Studies
- 20% Simulators (Hardware & Software) & Videos

In an unlikely event, the course instructor may modify the above training methodology before or during the course for technical reasons.

Course Fee

US\$ 5,500 per Delegate + **VAT**. This rate includes H-STK® (Howard Smart Training Kit), buffet lunch, coffee/tea on arrival, morning & afternoon of each day

Accommodation

Accommodation is not included in the course fees. However, any accommodation required can be arranged at the time of booking.

Course Program

The following program is planned for this course. However, the course instructor(s) may modify this program before or during the course for technical reasons with no prior notice to participants. Nevertheless, the course objectives will always be met:

Day 1: Monday, 08th of December 2025

0730 – 0800	Registration & Coffee
0800 – 0815	Welcome & Introduction
0815 – 0830	PRE-TEST
0830 – 0930	Introduction Terms, Definitions, Acronyms & Abbreviations • Cause of Overpressure & their Relieving Rates
0930 – 0945	Break
0945 – 1100	Overpressure Protection Philosophy Hierarchy of Protective Measures • Use of Administrative Controls if Corrected Hydrotest Pressure Not Exceeded • Double Jeopardy • Latent Failures • Operator Error/Effect of Operator Response • Role of Instrumentation in Overpressure Protection
1100 – 1215	Determination of Individual Relieving Rates General Philosophy • Effects of Pressure, Temperature, & Composition • Dynamic Simulation
1215 – 1230	Break



1230 – 1420	Individual Overpressure Causes & their Relieving Rates General • Closed Outlets • Cooling or Reflux Failure • Absorbent Flow Failure • Accumulation of Noncondensables • Entrance of Volatile Material into the System • Overfilling • Failure of Automatic Controls • Abnormal Process Heat or Vapor Input • Internal Explosions or Transient Pressure Surges • Chemical Reaction • Hydraulic Expansion • Fires • Heat Transfer Equipment Failure • Utility Failure • Overpressure Prevention During Maintenance
1420 – 1430	Recap
1430	Lunch & End of Day One

Day 2: Tuesday, 09th of December 2025

0730 – 0930	Guidance on Vacuum Relief General • Causes for Vacuum • Protection Against Vacuum
0930 – 0945	Break
0945 – 1100	Vapor Depressuring General • Initiation of Depressuring • Low Temperatures During Depressuring • Application Criteria • Acceptance & Design Criteria • Depressuring Rate • Vapor Flows
1100 – 1215	Relief System Design Documentation General • Purpose of Documentation • Potential Elements of Relief System Design Documentation
1215 – 1230	Break
1230 – 1420	Flare Header Design Documentation
1420 – 1430	Recap
1430	Lunch & End of Day Two

Day 3 : Wednesday, 10th of December 2025

0730 – 0930	Special Considerations for Individual PRDs General • Liquid-Vapor Mixture & Solids Formation • Location of a PRD in a Normally Liquid System • Multiple PRDs
0930 – 0945	Break
0945 – 1215	Fluid Properties that Influence Selection & Design of Disposal Systems Physical, Chemical, & Reactive Properties • Temperature • Hazardous & Nuisance Properties • Viscosity & Solidification • Miscibility • Recovery Value
1215 – 1230	Break
1230 – 1330	System Design Load General • Loads from Pressure Systems • Establishing Design Load for the Disposal System • Refinement of the Disposal System Design Load
1330 - 1420	System Arrangement General • Single-device Disposal Systems • Multiple-device Disposal System • Header Segregation
1420 – 1430	Recap
1430	Lunch & End of Day Three



Day 4: Thursday, 11th of December 2025

0730 – 0930	Piping General • Backpressure • Line Sizing • Multiple-relief Scenarios • Isothermal Pressure Drop Calculation Method • Lapple Pressure Drop Calculation Method • Fanno Lines Pressure Drop Calculation Method • Nonideal Gas Behavior • Frictional Resistance of Fittings (K-factors) • Mixed Phase Fluids • Mechanical Design of the Disposal System • Acoustic Fatigue • Setting the Mechanical Design Temperature for Flare Headers • Reaction Forces • Shock Loading • Pipe Anchors, Guides, and Supports • Self-draining/Heat Tracing • Routing of Discharge Piping/Sloping
0930 – 0945	Break
0945 – 1100	Disposal to a Lower-pressure System
1100 – 1215	Disposal to Flare General • Combustion Properties • Combustion Methods • Flare Systems Designs • Sizing • Purging • Ignition of Flare Gases • Liquid Seal Drum • Flare Knockout Drum • Siting Considerations for the Flare • Flare Gas Recovery Systems
1215 – 1230	Break
1230 – 1420	Disposal to Atmosphere Formation of Flammable Mixtures • Exposure to Toxic Vapors or Corrosive Chemicals • Ignition of a Relief Stream at the Point of Emission • Excessive Noise Levels Vent Stacks Air Pollution • Knockout Drums Venting to Atmosphere • Disposal Through Common Vent Stack • Sewer • Vent Stacks
1420 – 1430	Recap
1430	Lunch & End of Day Four

Day 5: Friday, 12th of December 2025

0730 – 0930	Design Details for Seal & Knockout Drum
0930 – 0945	Break
0945 – 1100	Analytical Methodology for Fire Evaluations
1100 – 1215	Special System Design Considerations & Calculations
1215 – 1230	Break
1230 – 1300	High-Integrity Protection System (HIPS)
1300 – 1315	Course Conclusion
1315 – 1415	COMPETENCY EXAM
1415 – 1430	Presentation of Course Certificates
1430	Lunch & End of Course

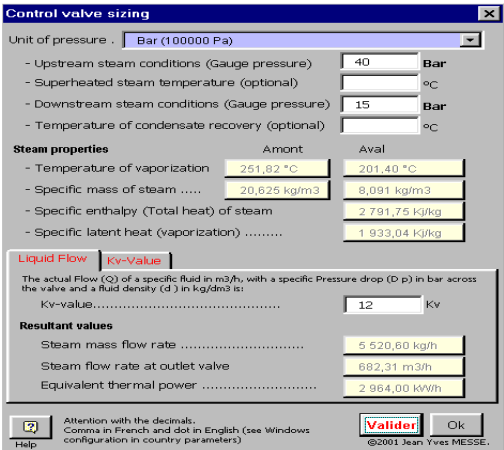
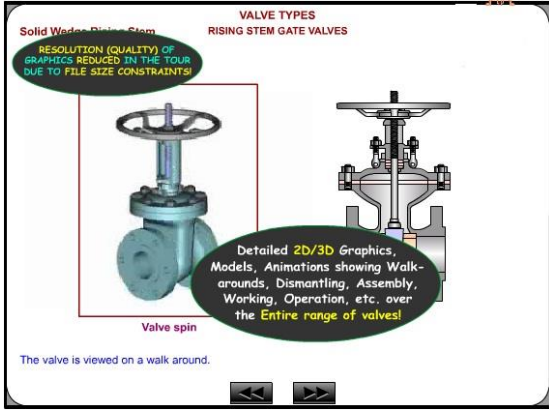
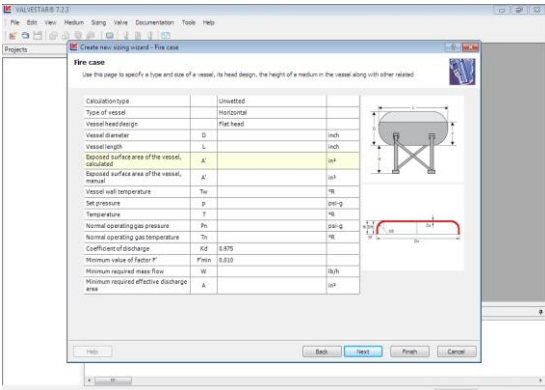
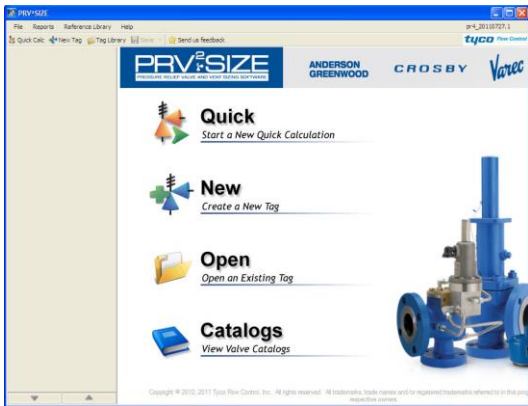
Valve Demo Kit

Hands-on demonstration will be held during the course. Proto-type safety relief valves will be temporary given to course participants for demonstration purposes as part of this course.



Simulator (Hands-on Practical Sessions)

Practical sessions will be organized during the course for delegates to practice the theory learnt. Delegates will be provided with an opportunity to carryout various exercises using the state-of-the-art “Valve Sizing Software”, “Valve Software 3.0”, “Valvestar 7.2 Software” and “PRV2SIZE Software”.

 <p>Control valve sizing</p> <p>Unit of pressure: Bar (100000 Pa)</p> <p>Upstream steam conditions (Gauge pressure): 40 Bar</p> <p>Superheated steam temperature (optional): °C</p> <p>Downstream steam conditions (Gauge pressure): 15 Bar</p> <p>Temperature of condensate recovery (optional): °C</p> <p>Steam properties</p> <p>Amont: 251,82 °C</p> <p>Aval: 201,40 °C</p> <p>Specific mass of steam: 20,625 kg/m³</p> <p>Specific enthalpy (Total heat) of steam: 2 791,75 kJ/kg</p> <p>Specific latent heat (vaporization): 1 933,04 kJ/kg</p> <p>Liquid Flow Kv-Value</p> <p>The actual Flow (Q) of a specific fluid in m³/h, with a specific Pressure drop (D p) in bar across the valve and a fluid density (ρ) in kg/dm³ is:</p> <p>Kv-value: 12 Kv</p> <p>Resultant values</p> <p>Steam mass flow rate: 5 520,60 kg/h</p> <p>Steam flow rate at outlet valve: 682,31 m³/h</p> <p>Equivalent thermal power: 2 864,00 kW/h</p> <p>Attention with the decimals. Comma in French and dot in English (see Windows configuration in country parameters)</p> <p>Validier OK</p> <p>©2001 Jean Yves MESSE.</p>	 <p>VALVE TYPES</p> <p>RISING STEM GATE VALVES</p> <p>Solid Wobler Rising Stem</p> <p>RESOLUTION (QUALITY OF GRAPHICS REDUCED IN THE TOUR DUE TO FILE SIZE CONSTRAINTS)</p> <p>Detailed 2D/3D Graphics, Models, Animations showing Walk-arounds, Dismantling, Assembly, Working, Operation, etc. over the Entire range of valves!</p> <p>Valve spin</p> <p>The valve is viewed on a walk around.</p>																																													
<p><u>Valve Sizing Software</u></p>	<p><u>Valve Software 3.0</u></p>																																													
 <p>Valvestar 7.2</p> <p>File Edit View Medium Sing Value Documentation Tools Help</p> <p>Project: New case</p> <p>Use this page to specify a type and size of a vessel, its head design, the height of a medium in the vessel along with other related</p> <table border="1"> <tr><td>Calculation type</td><td>Unsettled</td></tr> <tr><td>Type of vessel</td><td>Horizontal</td></tr> <tr><td>Vessel head design</td><td>Flat head</td></tr> <tr><td>Vessel diameter</td><td>D</td><td>inch</td></tr> <tr><td>Vessel length</td><td>L</td><td>inch</td></tr> <tr><td>Exposed surface area of the vessel, calculated</td><td>A</td><td>sq ft</td></tr> <tr><td>Exposed surface area of the vessel, manual</td><td>A</td><td>sq ft</td></tr> <tr><td>Vessel wall temperature</td><td>T_w</td><td>°F</td></tr> <tr><td>Set pressure</td><td>p</td><td>PSI-g</td></tr> <tr><td>Temperature</td><td>T</td><td>°F</td></tr> <tr><td>Normal operating pressure</td><td>P_N</td><td>PSI-g</td></tr> <tr><td>Normal operating temperature</td><td>T_N</td><td>°F</td></tr> <tr><td>Coefficient of discharge</td><td>K_d</td><td>0.875</td></tr> <tr><td>Minimum value of Factor F</td><td>F_{min}</td><td>0.02</td></tr> <tr><td>Minimum required mass flow</td><td>W</td><td>lb/h</td></tr> <tr><td>Minimum required effective discharge area</td><td>A</td><td>sq ft</td></tr> </table> <p>Back Next Finish Cancel</p>	Calculation type	Unsettled	Type of vessel	Horizontal	Vessel head design	Flat head	Vessel diameter	D	inch	Vessel length	L	inch	Exposed surface area of the vessel, calculated	A	sq ft	Exposed surface area of the vessel, manual	A	sq ft	Vessel wall temperature	T _w	°F	Set pressure	p	PSI-g	Temperature	T	°F	Normal operating pressure	P _N	PSI-g	Normal operating temperature	T _N	°F	Coefficient of discharge	K _d	0.875	Minimum value of Factor F	F _{min}	0.02	Minimum required mass flow	W	lb/h	Minimum required effective discharge area	A	sq ft	 <p>PRV²SIZE</p> <p>Anderson Greenwood Crosby Valtec tyco</p> <p>Quick: Start a New Quick Calculation</p> <p>New: Create a New Tag</p> <p>Open: Open an Existing Tag</p> <p>Catalogs: View Valve Catalogs</p> <p>Copyright © 2010, 2011 Tyco Flow Control, Inc. All rights reserved. All trademarks, trade names and/or registered trademarks referred to in this program are the property of their respective owners.</p>
Calculation type	Unsettled																																													
Type of vessel	Horizontal																																													
Vessel head design	Flat head																																													
Vessel diameter	D	inch																																												
Vessel length	L	inch																																												
Exposed surface area of the vessel, calculated	A	sq ft																																												
Exposed surface area of the vessel, manual	A	sq ft																																												
Vessel wall temperature	T _w	°F																																												
Set pressure	p	PSI-g																																												
Temperature	T	°F																																												
Normal operating pressure	P _N	PSI-g																																												
Normal operating temperature	T _N	°F																																												
Coefficient of discharge	K _d	0.875																																												
Minimum value of Factor F	F _{min}	0.02																																												
Minimum required mass flow	W	lb/h																																												
Minimum required effective discharge area	A	sq ft																																												
<p><u>Valvestar 7.2 Software</u></p>	<p><u>PRV²SIZE Software</u></p>																																													

Course Coordinator

Mari Nakintu, Tel: +971 2 30 91 714, Email: mari1@haward.org